


ATTACHMENT CLEARANCE TO TEMPORARY DECORATIVE ATTACHMENT WITH COMMUNICATION CABLE

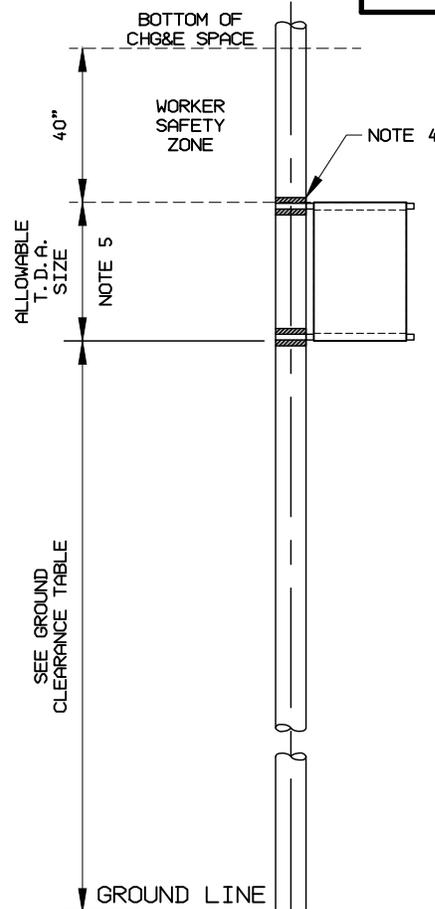

ATTACHMENT CLEARANCE TO TEMPORARY DECORATIVE ATTACHMENT WITHOUT COMMUNICATION CABLE

GROUND CLEARANCE TABLE ABOVE GROUND LINE	
LOCATIONS	MIN. T.D.A. GROUND CLEARANCE
AREAS ACCESSIBLE TO PEDESTRIANS	10 FT
DRIVEWAYS, ALLEYS AND PARKING LOTS	16 FT
TOWNS AND MUNICIPAL STREETS	16 FT
STATE HIGHWAYS AND COUNTY ROADS	18 FT

**NOTES:**

1. TEMPORARY DECORATIVE ATTACHMENT (T.D.A.) REPRESENTS BANNERS, FLAGS AND FLOWER POT ATTACHMENTS TO POLES.
2. ALL T.D.A.'S SHALL BE BELOW WORKER SAFETY ZONE.
3. T.D.A.'S SHALL BE 12" BELOW THE LOWEST COMMUNICATION CABLE (IF PRESENT).
4. T.D.A. SHALL BE ATTACHED TO POLES WITH BANDS OR STRAPS.
5. T.D.A. MAY BE UP TO 15 FT<sup>2</sup> OF SURFACE AREA FOR A CLASS 4 POLE. FOR LARGER T.D.A.'S CUSTOMER MUST NOTIFY CHG&E PRIOR TO INSTALLATION.
6. T.D.A.'S SHALL NOT BE ATTACHED TO A POLE WITH A RISER OR A CONTROLLER/CABINET.
7. CHG&E HAS THE FINAL SAY IN ALL MATTERS NOT SPECIFICALLY ADDRESSED IN THIS CONSTRUCTION STANDARD. CHG&E RESERVES THE RIGHT TO REJECT ANY APPLICATION OR INSTALLATION NOT IN COMPLIANCE WITH ALL GOVERNING STANDARDS. CHG&E ALSO RESERVES THE RIGHT TO REQUEST TO MOVE ANY LICENSEE EQUIPMENT THAT IMPEDES THE ABILITY TO PROVIDE ELECTRIC SERVICE TO FUTURE CUSTOMERS.
8. REFER TO CHG&E STANDARD E 01-02-006.0 FOR CLARIFICATION ON CHG&E SPACE AND JOINT POLE SPACE ALLOCATIONS.

ELECTRIC STANDARDS	CENTRAL HUDSON GAS & ELECTRIC CORP.	DATE 8/14/25
DRWN. GC	MUNICIPAL TEMPORARY DECORATIVE ATTACHMENT (T.D.A.) ATTACHMENTS TO POLES	ISSUE 1
CLEAR MGE		APP. NRC
ENGR. WPB		APP. JHM
APPD. WPB		