

CENTRAL HUDSON GAS & ELECTRIC CORPORATION

CASE 17-E- & CASE 17-G-

ELECTRIC RELIABILITY PANEL

SCHEDULE OF EXHIBITS

5 YEAR PERFORMANCE INDICES (SAIFI & CAIDI) (ERP-1)

2011 – 2016 TREE RELATED SAIFI (ERP-2)

2011 – 2016 TREE AND NON-TREE SAIFI (ERP-3)


Central Hudson Gas & Electric Corporation
 Case 17-E- _____ & Case 17-G- _____
 5 YEAR PERFORMANCE INDICES (SAIFI & CAIDI)

The table below summarizes Central Hudson's performance over a period of five years. The SAIFI indices are calculated by dividing the total number of customers interrupted by the total number of customers served. The CAIDI indices are calculated by dividing the sum of the customer interruption durations by the total number of customers interrupted.

	SAIFI (Without Storms)	CAIDI (Without Storms)	SAIFI (With Storms)	CAIDI (With Storms)
2012	1.00	2.38	1.80	8.55
2013	1.02	2.30	1.06	2.36
2014	1.24	2.27	1.61	3.74
2015	1.28	2.07	1.38	2.09
2016	1.33	2.34	1.44	2.51
5-Year Average	1.17	2.27	1.46	3.85

Central Hudson Gas & Electric Corporation
 Case 17-E- _____ & Case 17-G- _____
 2011 – 2016 TREE RELATED SAIFI

The chart below summarizes Central Hudson’s tree contact SAIFI performance from 2011 through 2016. Tree contacts are further subdivided into four categories: Tree/Limb Outside Clearance Zone, Tree/Limb in Clearance Zone, Tree Growth, and Vines. The SAIFI indices are calculated by dividing the total number of customers interrupted by the tree related system by the total number of customers served.

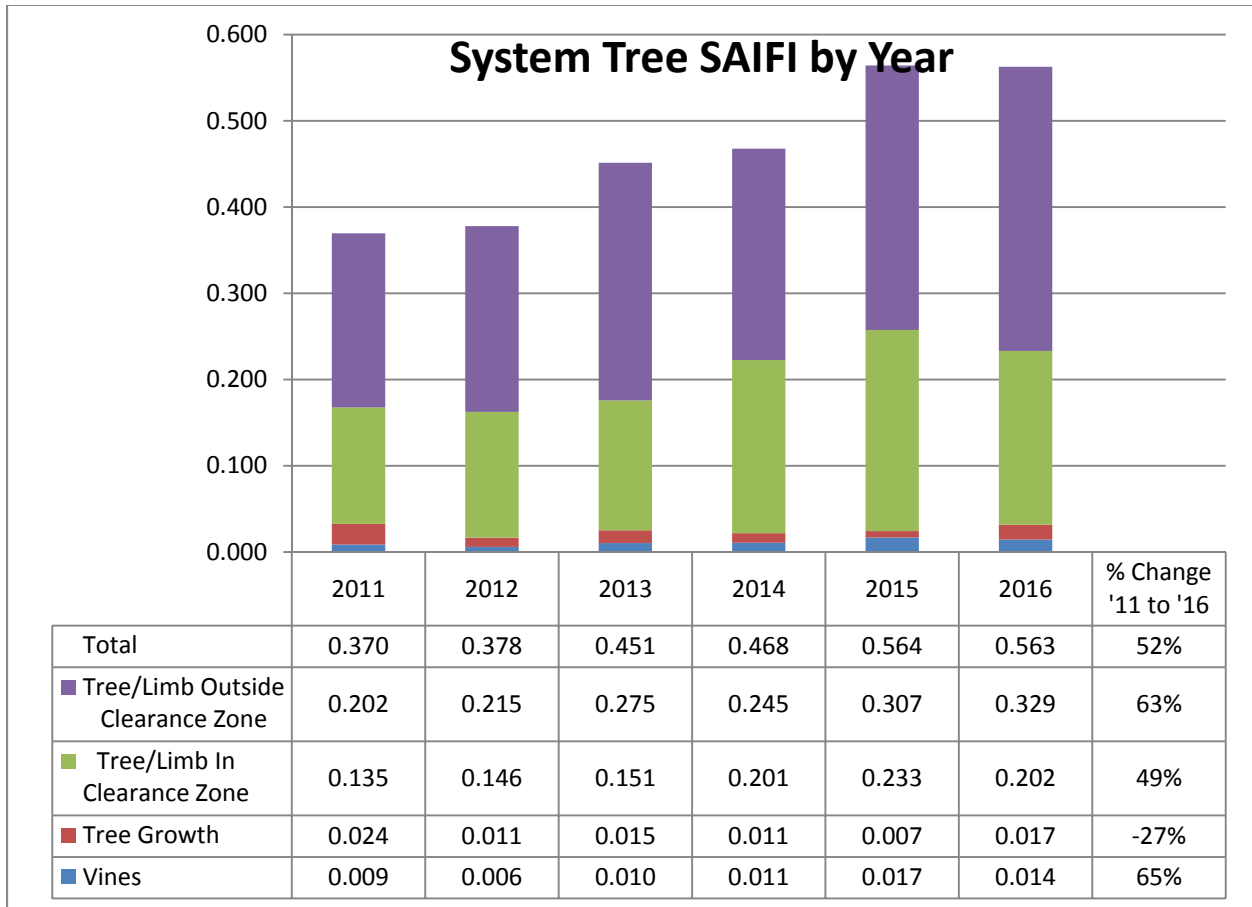

Central Hudson Gas & Electric Corporation
 Case 17-E- _____ & Case 17-G- _____
 2011 – 2016 Tree and Non-Tree SAIFI

The chart below illustrates the non-storm, tree-contact and non-tree contact SAIFI for 2011-2016 along with the penalty levels for each of those years.

